




2016

**CA MECHANICAL CODE
904.1, 904.2, 904.7**

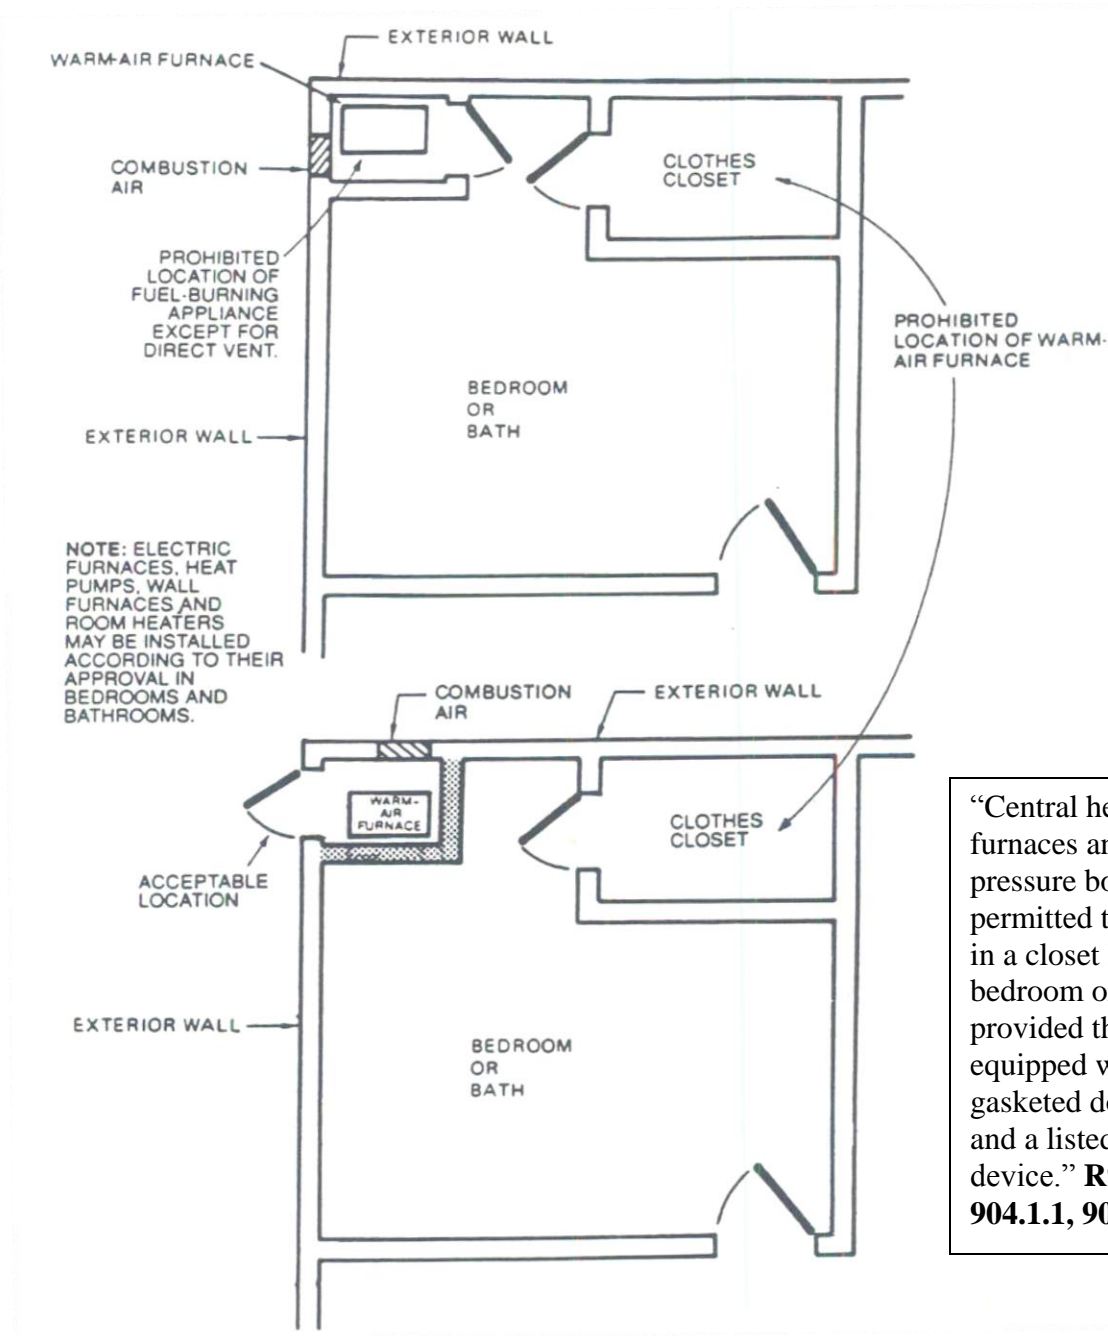

“Central heating furnaces and low-pressure boilers shall be permitted to be installed in a closet located in the bedroom or bathroom, provided the closet is equipped with a listed, gasketed door assembly, and a listed self-closing device.” **R904.1, 904.1.1, 904.1.2**